

DETERMINING THE OPERATING TIME OF THE ELECTROINSULATING OIL FOR POWER TRANSFORMERS

CÂRLAN M.*., OLTEAN M.**, A.SAS***
 *S.C. FORMENERG S.A.,** University of Oradea, ymoltean@yahoo.com
 ***S.C. Hidroserv Hațeg S.A.

Abstract: This paper presents a way of assessing the durability of the electroinsulating oil used on medium/low voltage power transformers owned by the national electricity supplier (SDFE) in Oradea. Statistics about the operation durations, before replacing the electroinsulating material, reveal a Rayleigh non-exponential distribution, specific for the degradable products, exclusively due to aging.

Key words: durability, Rayleigh non-exponential distribution, statistics, degradable products.

1. INTRODUCTION

Surface tension of the electroinsulating oils represents a physical attribute of these products and indicate the force exerted per unit length of the oil-water layer. The level of the surface tension can reveal an image of the oxidized product quantity in the oil mass. The allowed value for the surface tension, according to the international quality norm, ASTM/D 3487, is 40 Dyn/cm (0,04 N/m) and corresponds to pure oil. Norms in Romania, NI Astra Romana 39/1999, 57/1999 indicate the same number.

The minimum level admitted is 0,0255 N/m. Below this value, the process of mud forming is amplified, in this case being recommended the improvement or replacement of oil.

Within SDFE Oradea, the corrective maintenance is exclusively practiced – replacing the oil when the surface tension is at the critical level: 0,014 – 0,022 N/m.

Figure 1 represents the graph of surface tension evolution during the operating time accepted.

2. CASE STUDY

The analysis in this paper focuses on a group of seven medium/low voltage power transformers the operating time of which are revealed in table 1.

Table 1. Group of medium/low voltage power transformers the operating time

i	1	2	3	4	5	6	7
t_i	11	9	8	13	10	13,5	9
$[year]$							

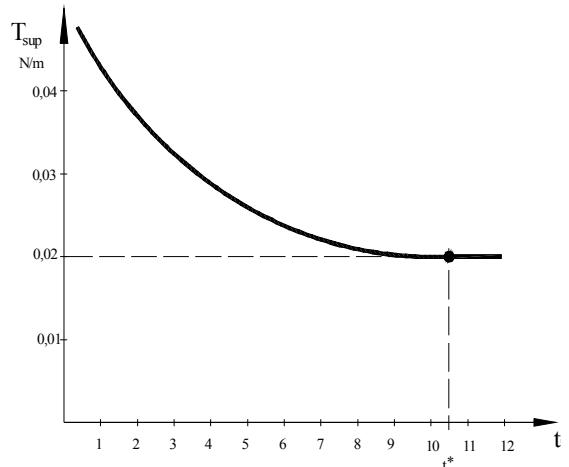


Fig.1. The graph of surface tension evolution during the operating time accepted

2. VALIDATION OF THE RAYLEIGH MODEL OF THE OPERATING TIME FOR ELECTROINSULATING OIL

The Rayleigh distribution represents a version of the Weibull distribution, meaning that the distribution function

$$F(t) = 1 - \exp(-\theta t^\beta) \quad (1)$$

has the following form:

$$F(t) = 1 - \exp(-\theta t^2) \quad (2)$$

(form parameter, $\beta=2$)

Table 2 is made to verify this model:

Table 2. Results to verify the models

i	t_i	t_{i+1}	$\Delta M(z_i)$	I_i
1	8	1	1,079055	0,92673682
2	9	0	0,591587	0,00000000
3	9	1	0,442789	2,25841202
4	10	1	0,387280	2,58211134
5	11	2	0,387714	5,15844153
6	13	0,5	0,480648	0,96129600
7	13,5	-	-	-
\sum_i				11,88699771

The values for the $\Delta M(z)$ quantile are extracted from table 2, based on statistical sample volume n and on the level of verisimilitude P , extracted from table 3.

Table 3. Extracted values

r	i	$\Delta M(z_i)$	P	
			0,90	0,95
3	1	1,216395		
	2	0,863046		
	3	-	0,90	0,95
4	1	1,150727		
	2	0,706698		
	3	0,6795960	0,90	0,95
	4	-	0,67	0,76
5	1	1,115718		
	2	0,645384		
	3	0,532445	0,90	0,95
	4	0,583273	0,68	0,77
	5	-	0,79	0,86
6	1	1,093929		
	2	0,612330		
	3	0,474330	0,90	0,95
	4	0,442920	0,68	0,76
	5	0,522759	0,80	0,86
	6	-	0,66	0,73
7	1	1,079055		
	2	0,591587		
	3	0,442789	0,90	0,95
	4	0,387280	0,68	0,77
	5	0,387714	0,80	0,86
	6	0,480648	0,67	0,74
	7	-	0,74	0,80
8	1	1,068252		
	2	0,577339		
	3	0,422889	0,90	0,95
	4	0,356967	0,68	0,77
	55	0,334089	0,80	0,86
	6	0,349907	0,67	0,74
	7	0,449338	0,74	0,80
	8	-	0,65	0,71
9	1	1,060046		
	2	0,566942		
	3	0,409157	0,90	0,95
	4	0,337763	0,68	0,77
	5	0,304777	0,80	0,86
	6	0,297949	0,67	0,75
	7	0,322189	0,74	0,80
	8	0,424958	0,66	0,72
	9	-	0,71	0,76
10	1	1,053606		
	2	0,559013		
	3	0,399100	0,90	0,95
	4	0,324470	0,68	0,77
	5	0,286163	0,80	0,86
	6	0,269493	0,68	0,75
	7	0,271645	0,75	0,81
	8	0,300809	0,66	0,72
	9	0,405316	0,71	0,76
	10	-	0,61	0,69

The calculation of the 1 size is based on the following relation:

$$l_i = \frac{t_{i+1} - t_i}{\Delta M(z_i)} \quad (3)$$

the following statistics is calculated:

$$S^* = \frac{\sum_{i=\left[\frac{n}{2}\right]+1}^{n-1} l_i}{\sum_{i=1}^{n-1} l_i} \quad (4)$$

Where $\left[\frac{n}{2}\right]$ is the whole of the fraction;

so:

$$S^* = \frac{\sum_{i=3+1}^5 l_i}{\sum_{i=1}^6 l_i}$$

Results that :

$$S^* = \frac{8,70184}{11,88700} \Rightarrow S^* \cong 0,73$$

From table 3 the quantile of the $S_{n=7; P=0,95}$ test is taken

$$S_{n=7; P=0,95} \in [0,8 - 0,95]$$

The hypothesis of the model is confirmed by the inequality:

$$S^* < S_{n;P} \quad (5)$$

Results that

$$S^* = 0,73 < S_{n=7; P=0,95} \in [0,80; 0,95]$$

3. CALCULATION OF THE OPERATING TIME OF THE ELECTROINSULATING OIL

According to this statistical distribution, the durability of a product is expressed by the formula:

$$M(T) = \theta \Gamma\left(\frac{I}{k} + 1\right) \quad (6)$$

or

$$M(T) = \theta \Gamma\left(\frac{I}{2} + 1\right) \quad (7)$$

($\beta = 2$ for Rayleigh distribution).

The gamma function $\Gamma\left(\frac{1}{2} + 1\right)$ is deduced from table 4,

depending on the parameter $\beta = 2$; so $\Gamma\left(\frac{1}{2} + 1\right) = 0,8862$

Table 4. The gamma function

k	V_k	g_k	CV
0,200	120,0000	1901,0000	15,8400
0,300	9,2610	50,0800	5,4080
0,400	3,3230	10,4400	3,1410
0,500	2,0000	4,4720	2,2360
0,600	1,5050	2,6450	1,7580
0,700	1,2660	1,8510	1,4620
0,800	1,1330	1,4280	1,2610
0,900	1,0520	1,1710	1,1130
1,000	1,0000	1,0000	1,0000
1,100	0,9649	0,8783	0,9102
1,200	0,9407	0,7872	0,8369
1,300	0,9236	0,7164	0,7757
1,400	0,9114	0,6596	0,7238
1,500	0,9027	0,6129	0,6700
1,600	0,8966	0,5737	0,6399
1,700	0,8922	0,5402	0,6056
1,800	0,8893	0,5112	0,5749
1,900	0,8874	0,4858	0,5475
2,000	0,8862	0,4638	0,5227
2,500	0,8873	0,3797	0,4279
3,000	0,8930	0,3246	0,3634
3,500	0,8997	0,2847	0,3165
4,000	0,9064	0,2543	0,2805
4,500	0,9126	0,2301	0,2521
5,000	0,9182	0,2103	0,2291
7,000	0,9354	0,1572	0,1680
10,000	0,9514	0,1145	0,1203

As for parameter θ , it will be calculated according table 5 data.

Table 5. Calculated data for θ parameter

i	t_i	\bar{t}	t_i - \bar{t}	(t_i - \bar{t})²
1	8		-2,5	6,25
2	9		-1,5	2,25
3	9		-1,5	2,25
4	10	10,5	-0,5	0,25
5	11		+0,5	0,25
6	13		+2,5	6,25
7	13,5		+3,0	9,00
\sum_i	73,5			26,50

Parameter θ – the failure rate– is deduced from the following formula:

$$\theta = \frac{\sigma}{\xi_k} \quad (8)$$

Where σ is the standard deviation of the variable values from its mean value, \bar{t} :

$$\sigma = \sqrt{\frac{\sum_i (t_i - \bar{t})^2}{n}} \quad (9)$$

It's obtained:

$$\sigma = \sqrt{\frac{26,50}{7}} \Rightarrow \sigma \approx 1,9457$$

The value of ξ is deduced from table 4 depending on the variation coefficient, CV:

$$CV = \frac{\sigma}{t} \quad (10)$$

Results :

$$CV = \frac{1,9457}{10,5} \Rightarrow CV = 0,1853$$

By interpolation, $\xi_k \approx 0,18$ is set.

According to formula (8), the value for the θ parameter is obtained:

$$\theta = \frac{1,9457}{0,18} \Rightarrow \theta \approx 10,8$$

The durability of the electroinsulating oil is obtained from relation (7):

$$\tau = M(T) \approx 9,6 \text{ years}$$

4. CONCLUSIONS

The durability of electroinsulating oil is influenced by a series of mechanical, electrical and chemical measures (properties), all of these conditioning the quality of the protective product.

Knowing the limit values of these determinants factors, their temporal evolution, cause an accurate imagine to anticipate the critical moment of operation, and therefore the opportunity for improvement or replacement the electroinsulating material operational compromise.

REFERENCES

- [1]. Vodă V. Gh., Controlul durabilității produselor industriale. Ed. Tehnică, București, 1981
- [2]. Felea I., Boja I., Coroiu N., Chereches O. - Influența gradului de solicitare asupra stării uleiului electroizolant din transformatoarele electrice de putere. JOURNAL OF SUSTENABLE ENERGY – vol. I, No.3, 2009
- [3]. Oltean,M. Cârlan M. - Models for evaluating the durability of electroinsulating materials, JOURNAL OF SUSTENABLE ENERGY – vol. I, No.3, 2010
- [4]. Popa I., Ceclan R.E., Ceclan M. - Mantenarea uleiurilor minerale. Ed. ELECTRA, București 2009